

# Water Resources / Supply Report

Agenda Item 14


May 5, 2010

# Supply Conditions


- All Executive Orders from SWFWMD associated with Authority facilities have been rescinded
- Raw water reservoirs are near full
- Demand on the PRF is about 21 mgd
- Water quality is excellent

# Regional Water Supply


## 4-County Area

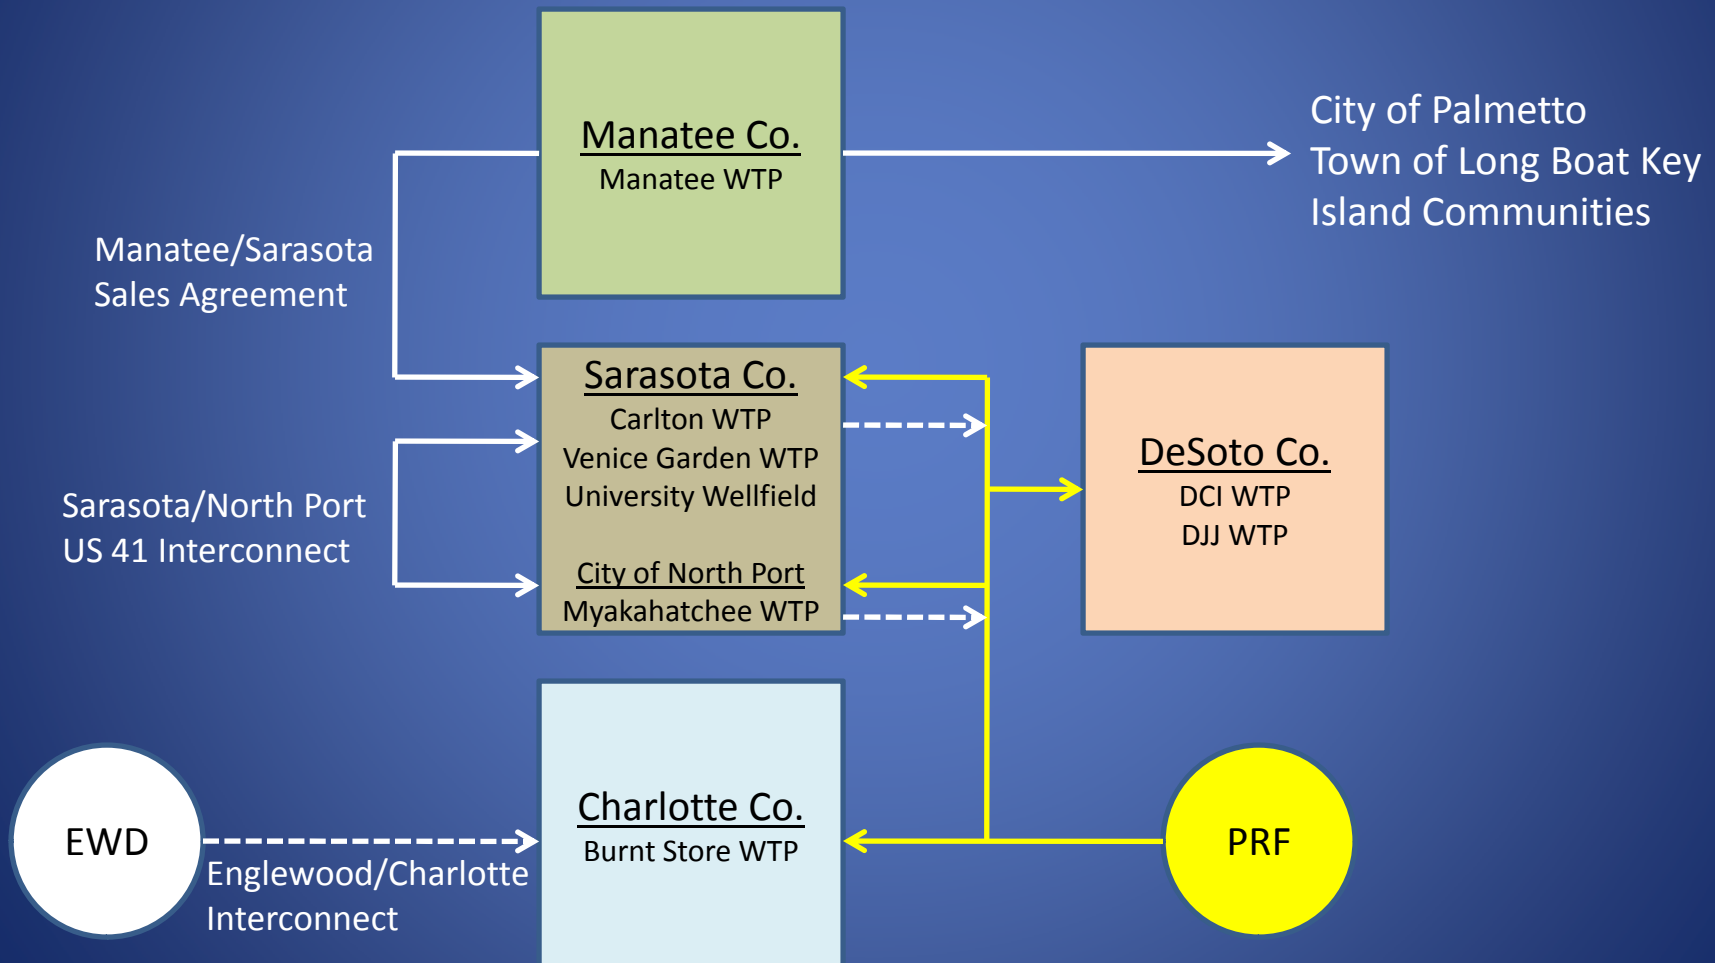

# Interconnected Regional System

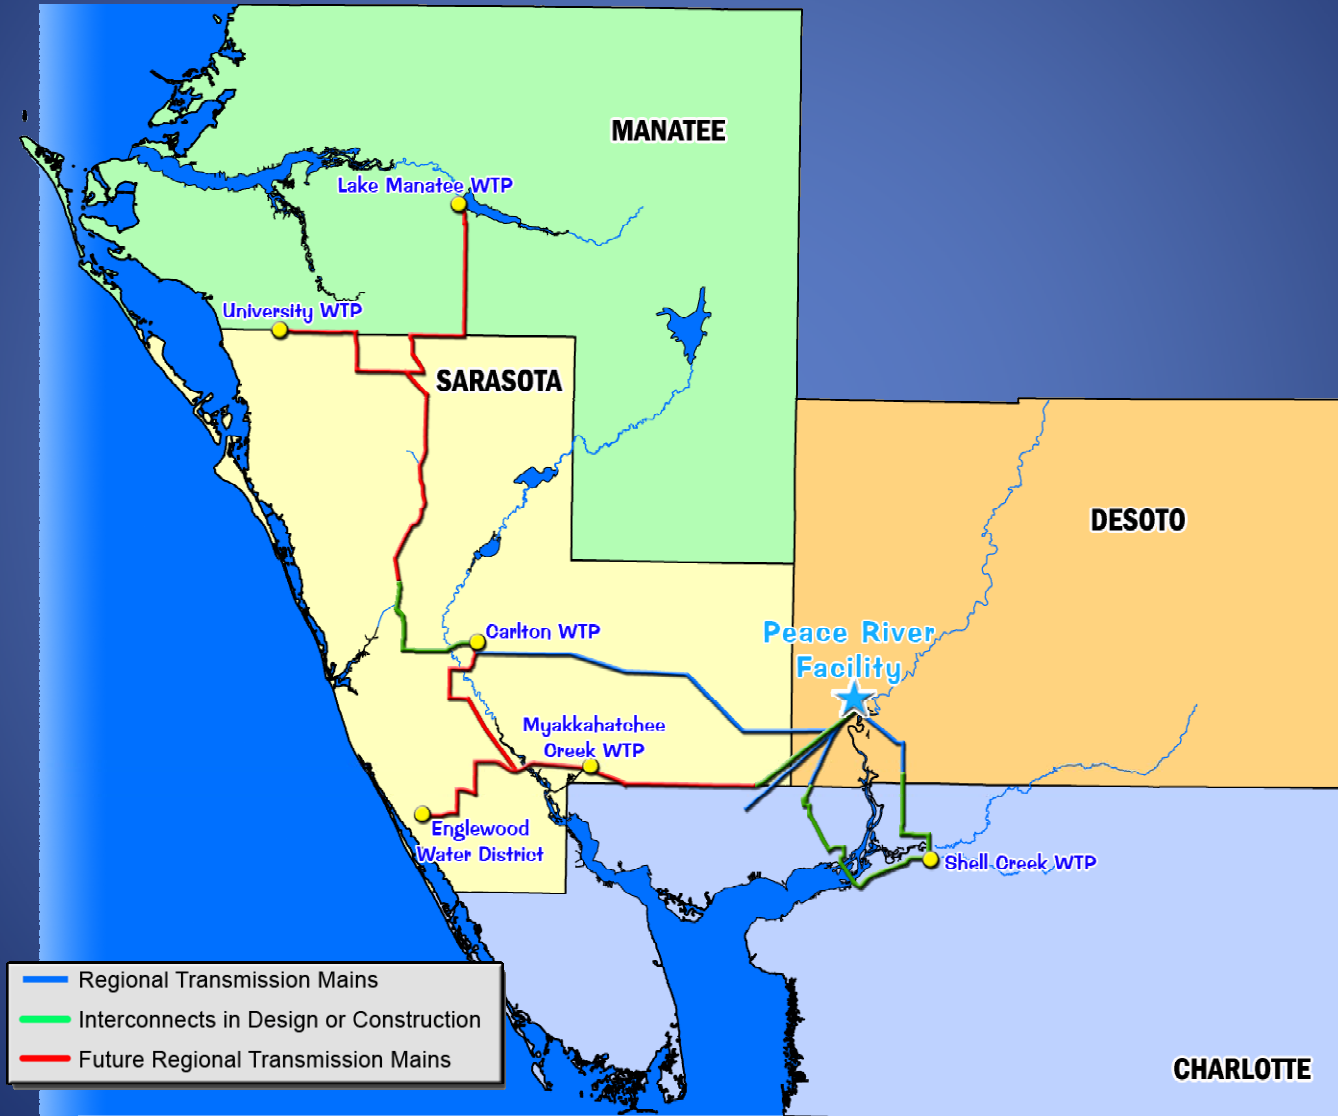


# Authority Customer Finished Water Supply Capacity

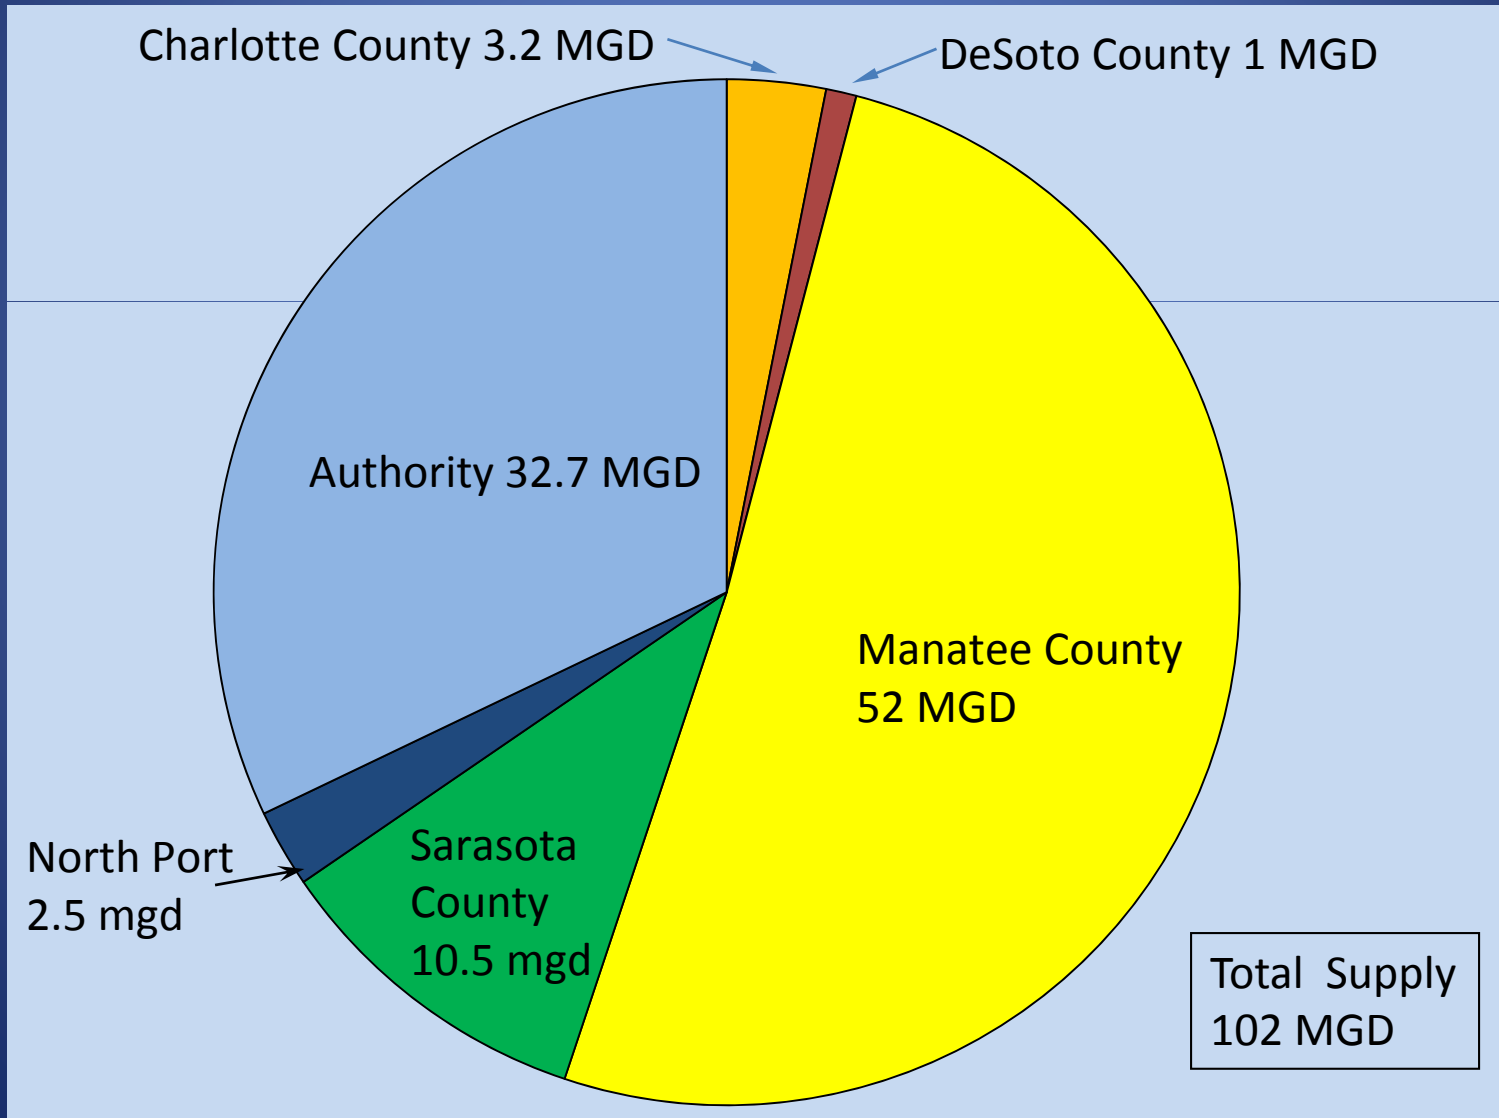


# Authority Customer Water Production

Water Production  
by Facilities  
March 2010

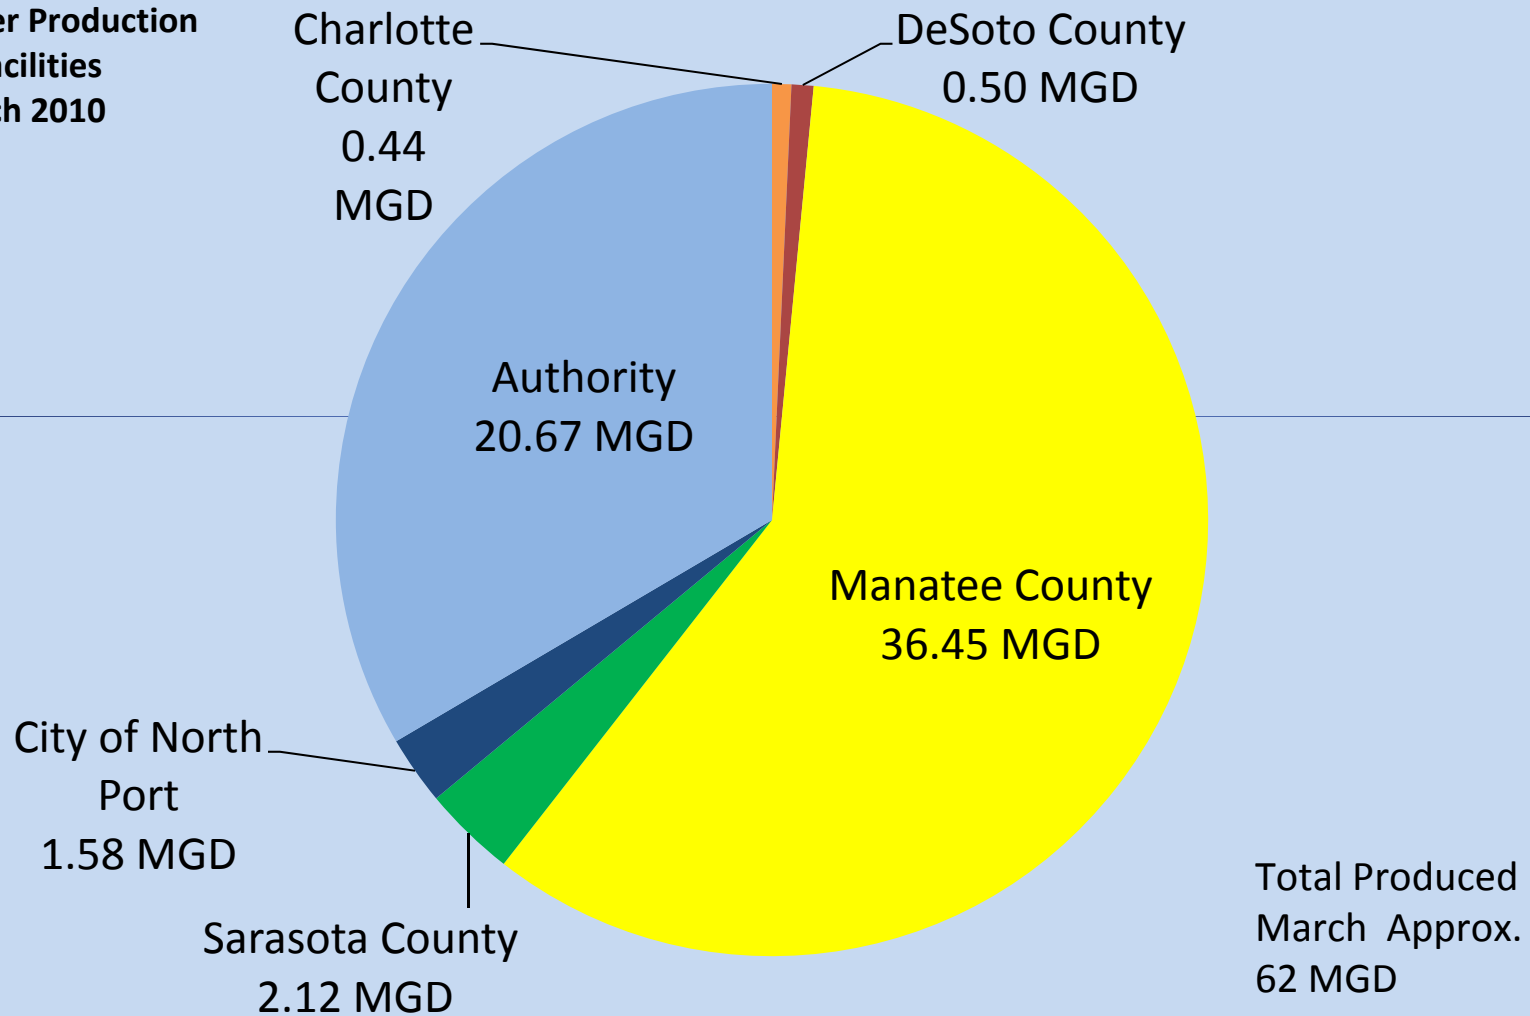


# Production Capacity vs Capacity Used

Total Capacity  
102 MGD

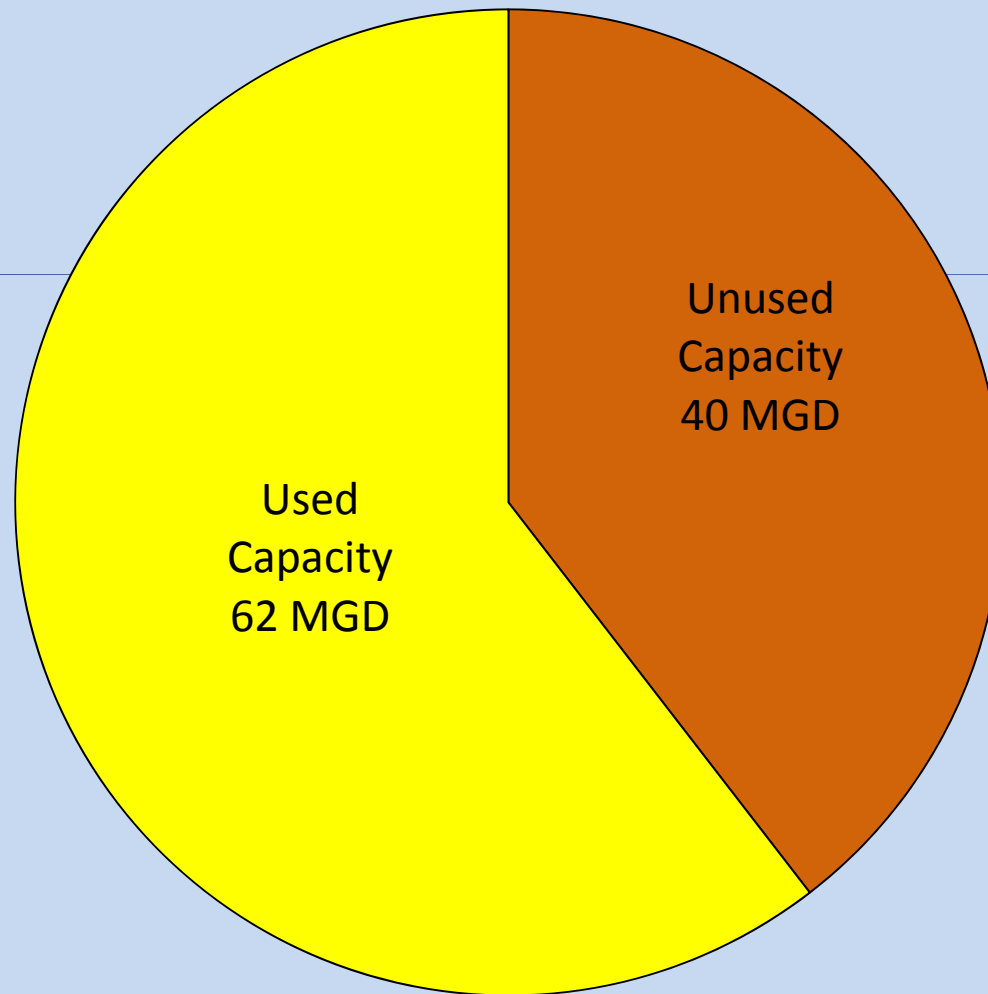


# Authority & Customer Unused Capacity

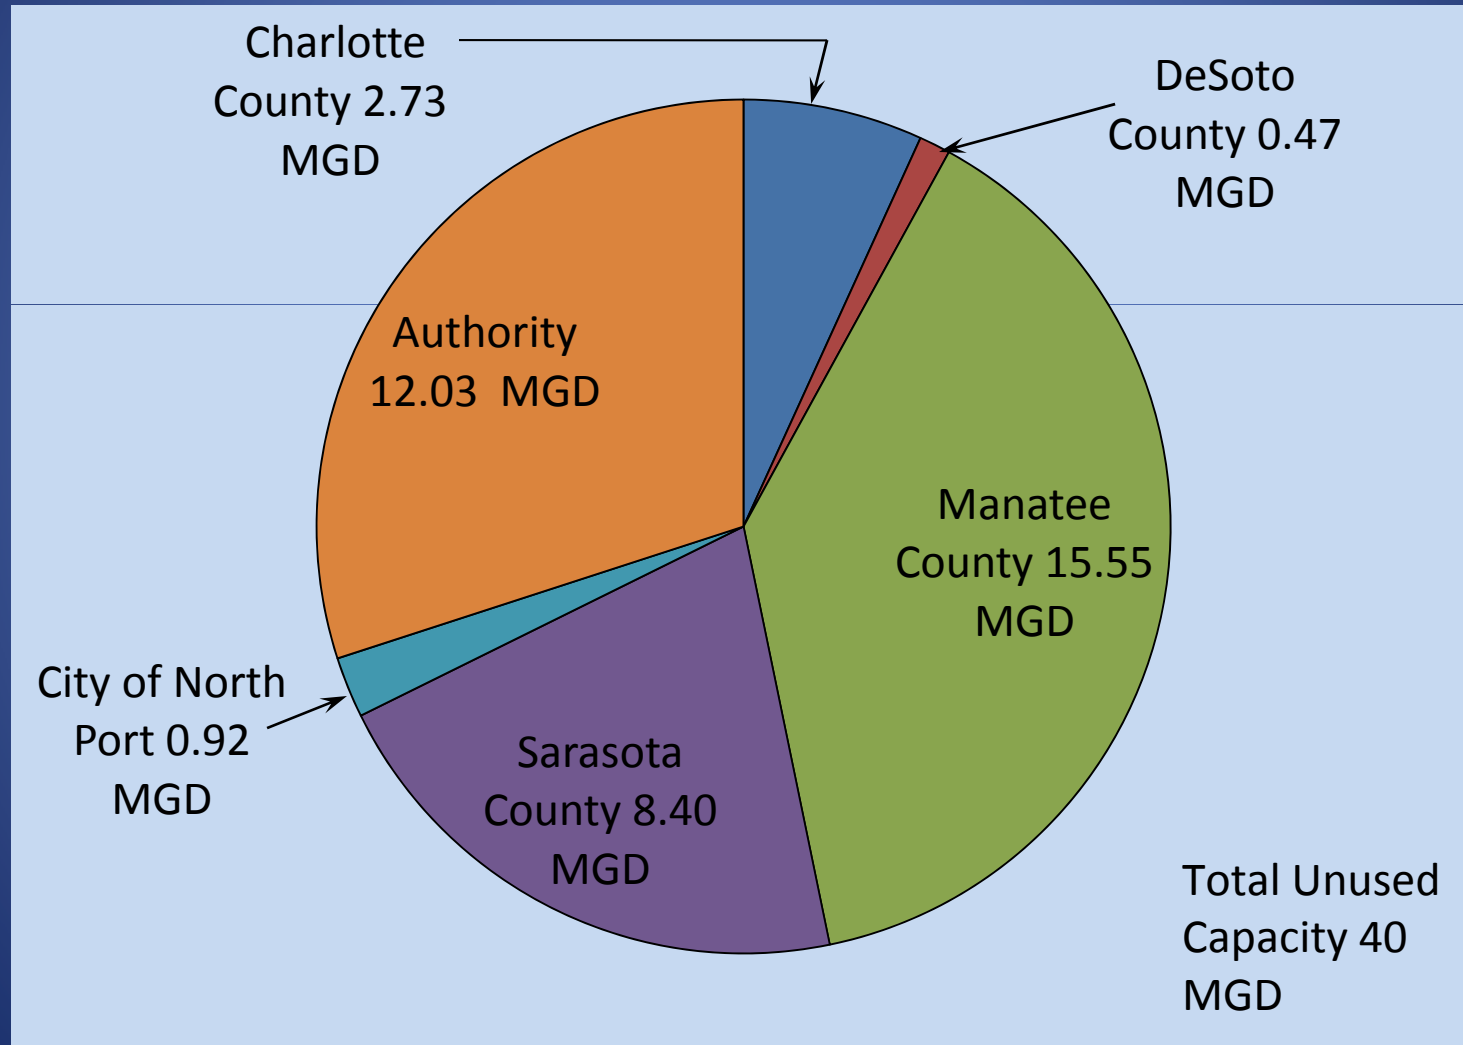

# Individual Customer Use


Charlotte County

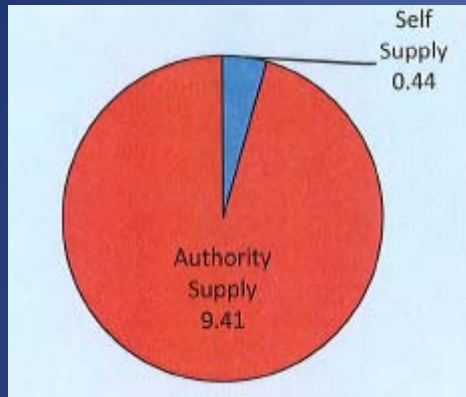


DeSoto County




Manatee County

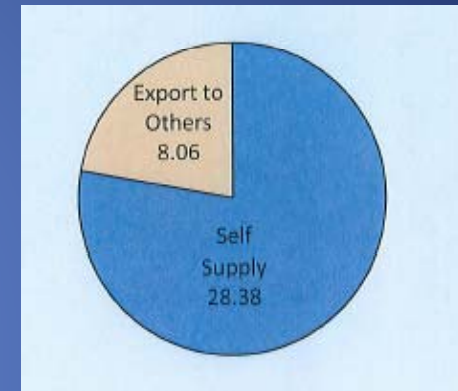


Sarasota County

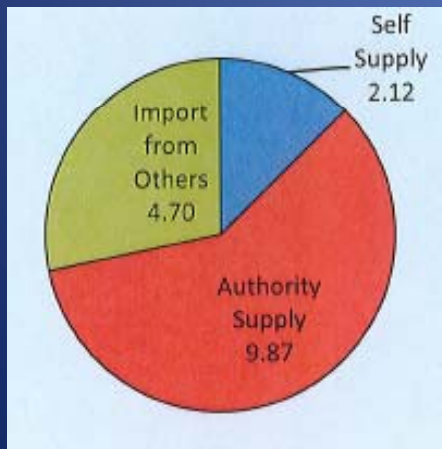

North Port

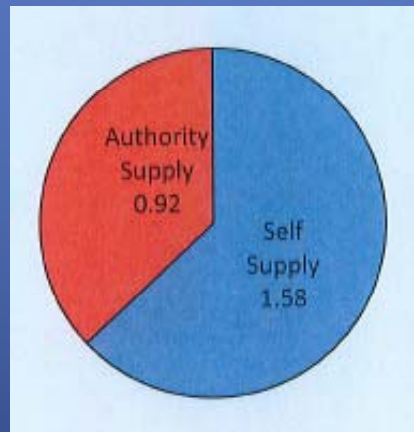

# Interconnected Regional System

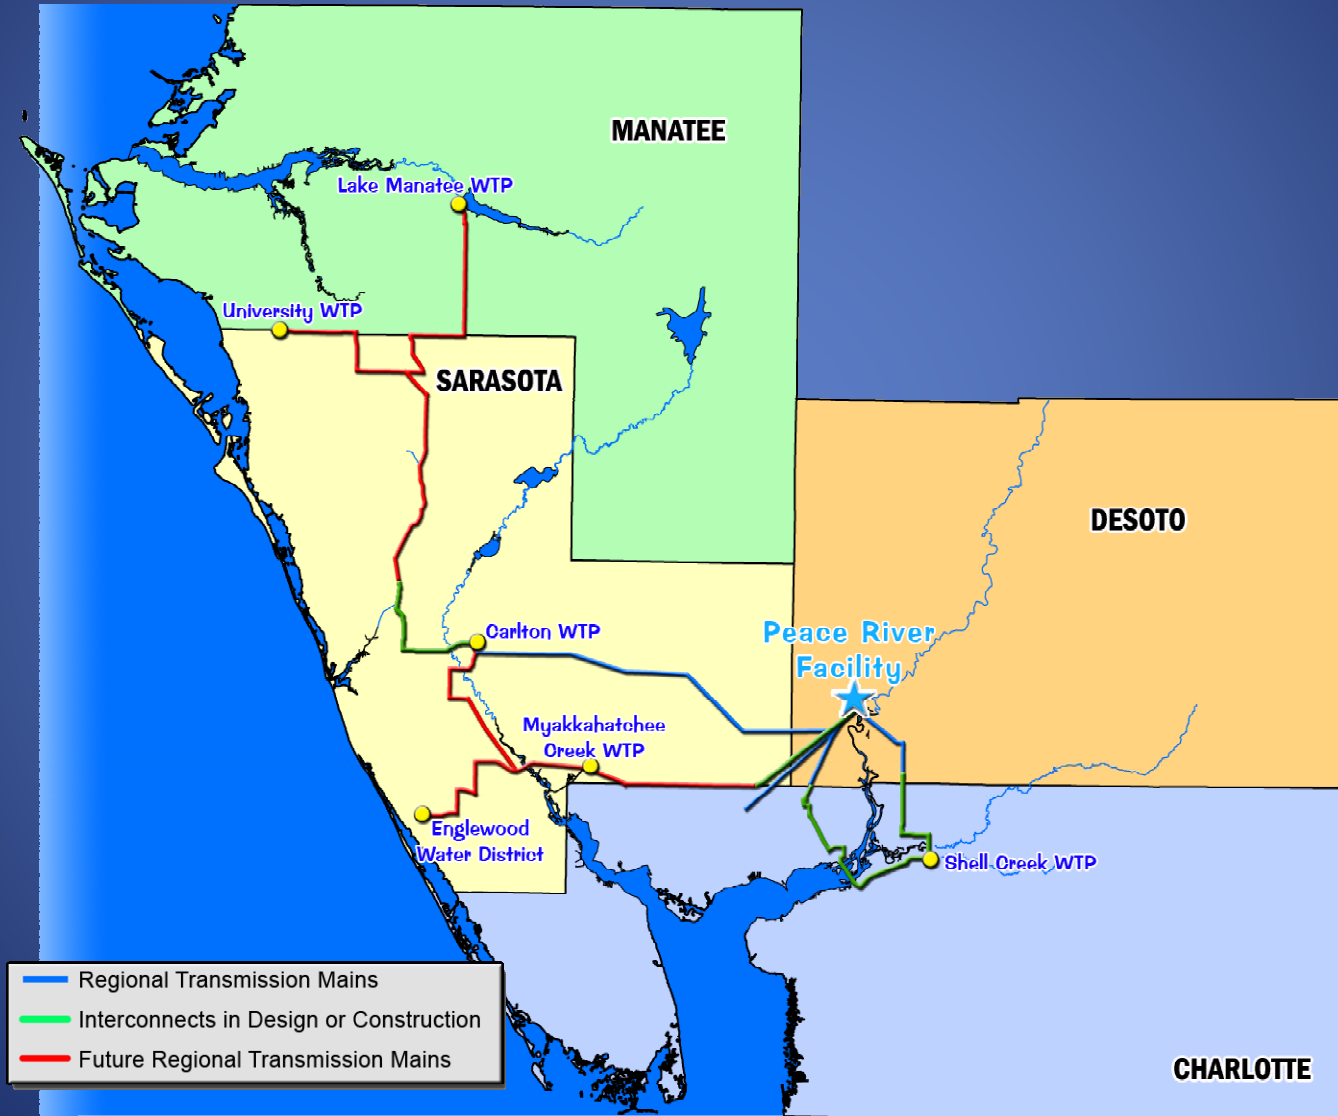

Questions