

Water Resources / Supply Report


Agenda Item 14
September 1, 2010

Supply Conditions


- Raw water reservoirs are 96% full
- ASR Storage increased by 355 MG since recharge began (July 22)
- Demand on the PRF is about 21 MGD
- Water quality is excellent

Regional Water Supply


4-County Area (including Phase 1A Interconnect)

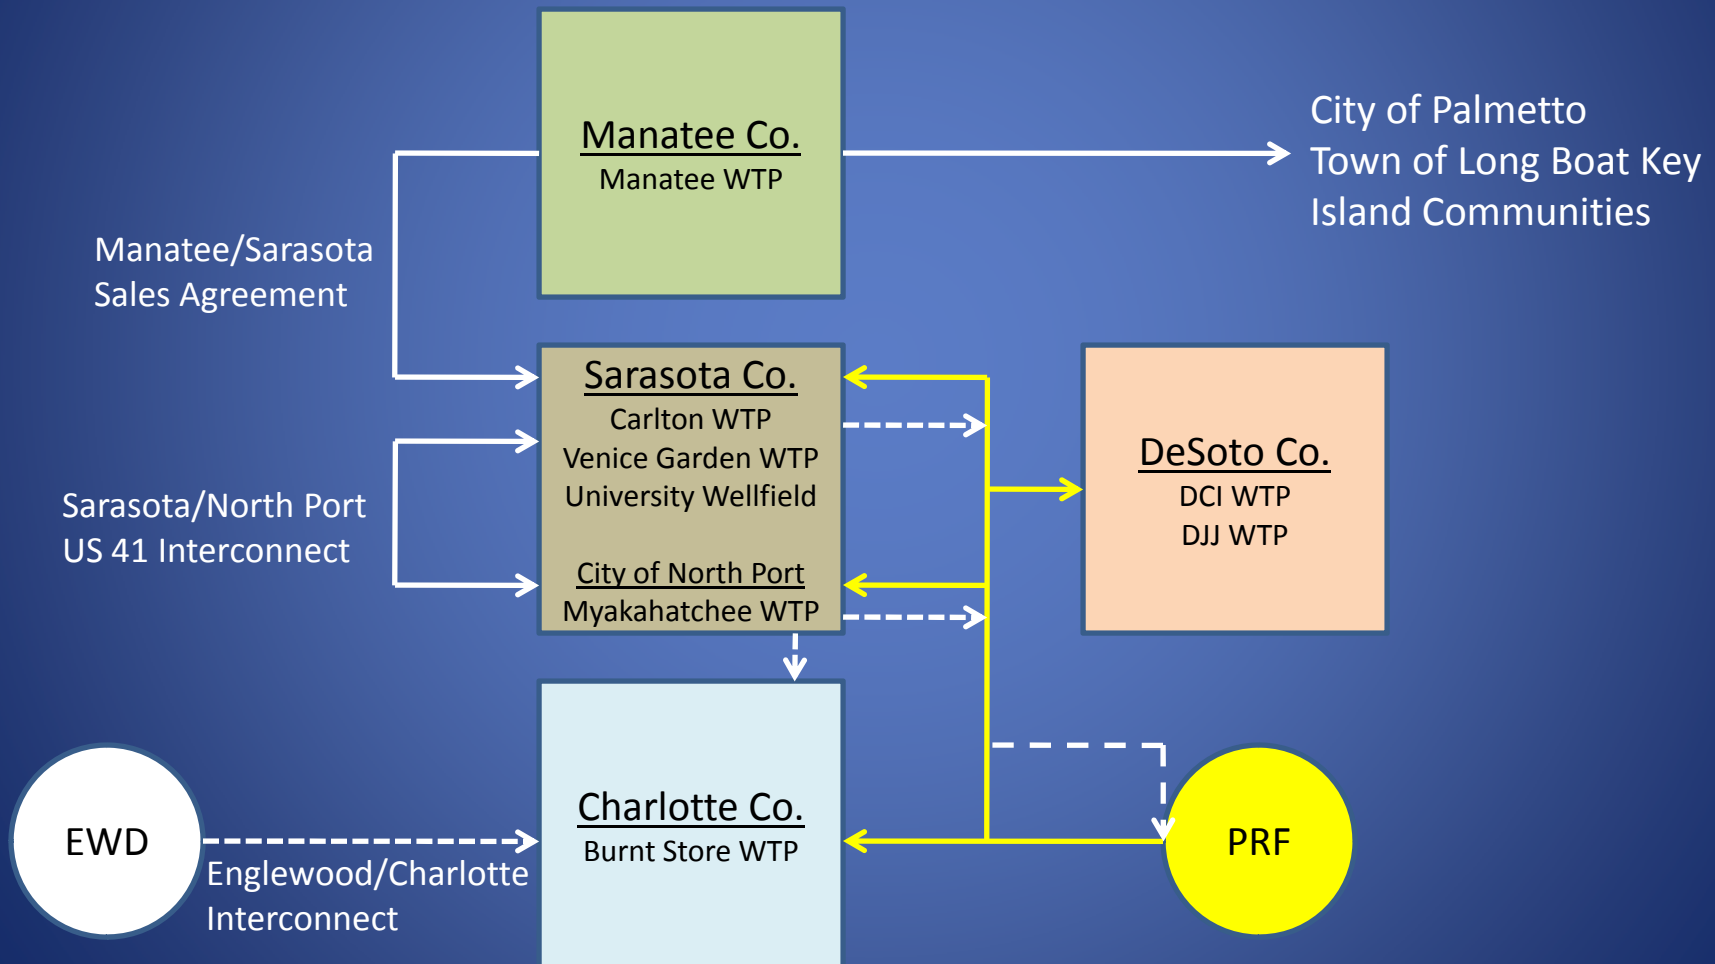


Interconnected Regional System

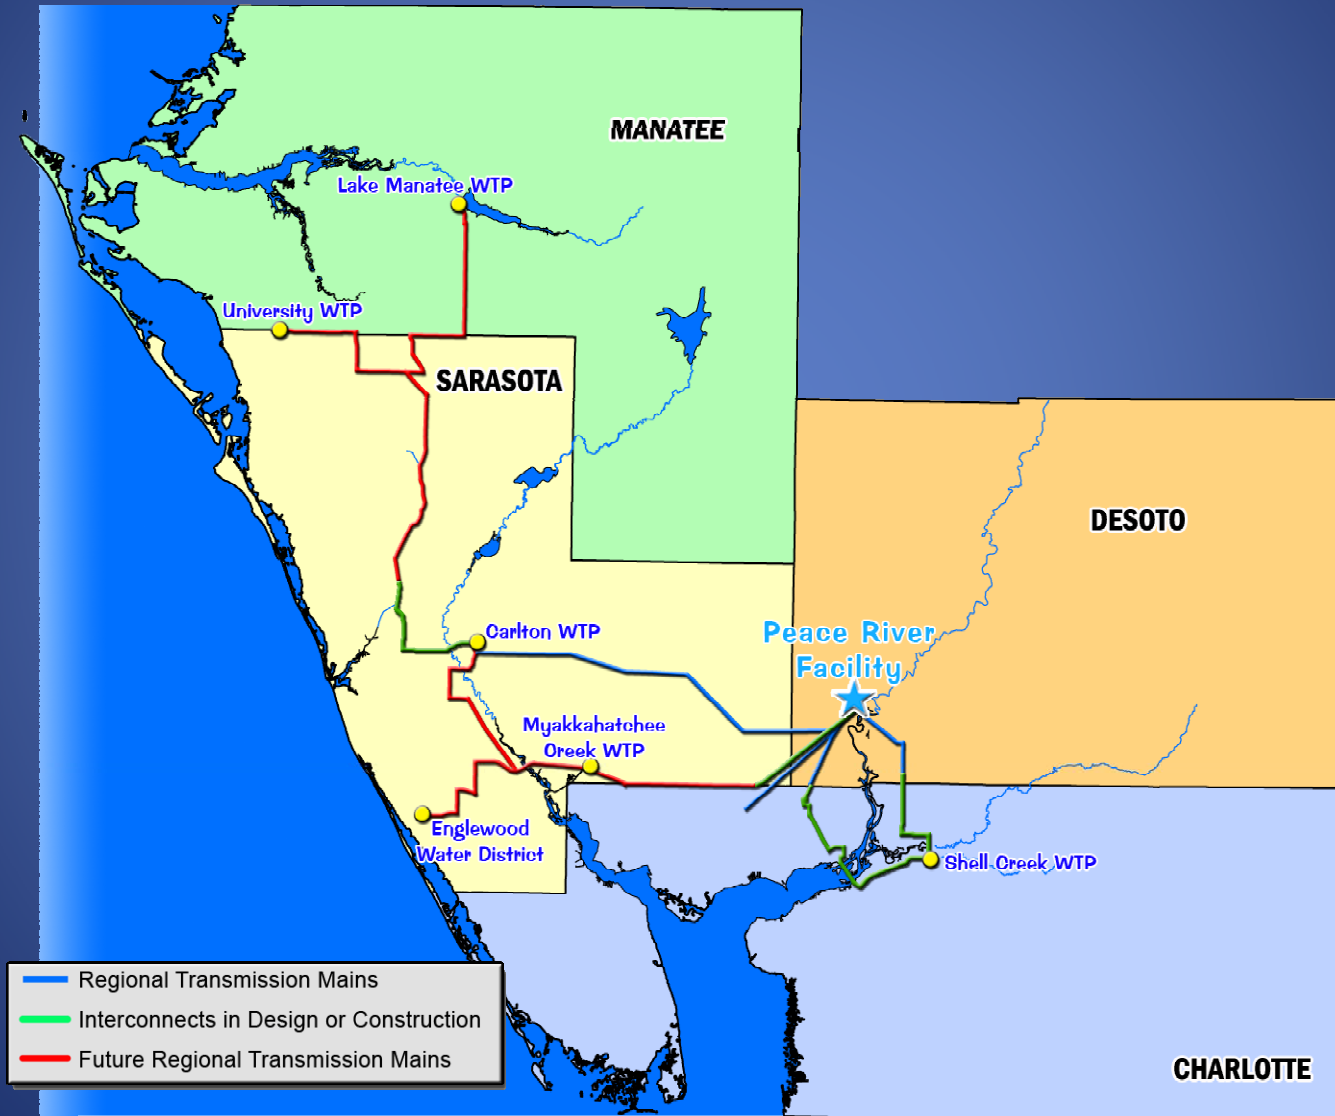

Authority Customer Finished Water Supply Capacity

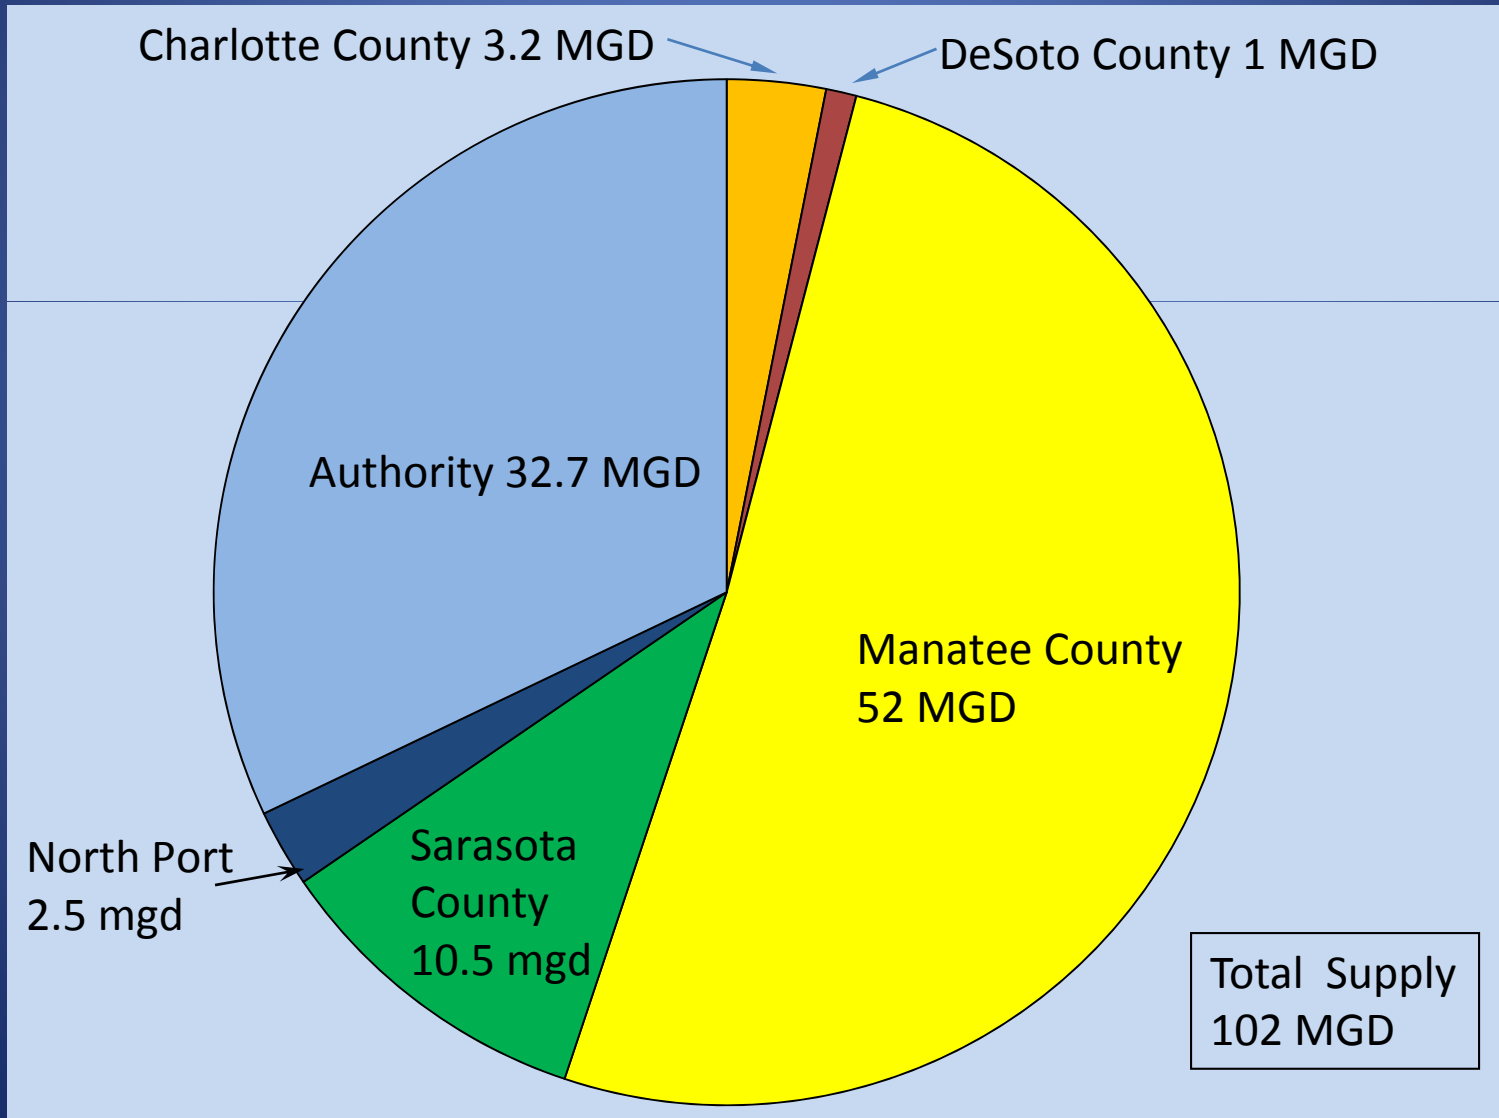


Authority & Customer Water Production (MGD) - July 2010

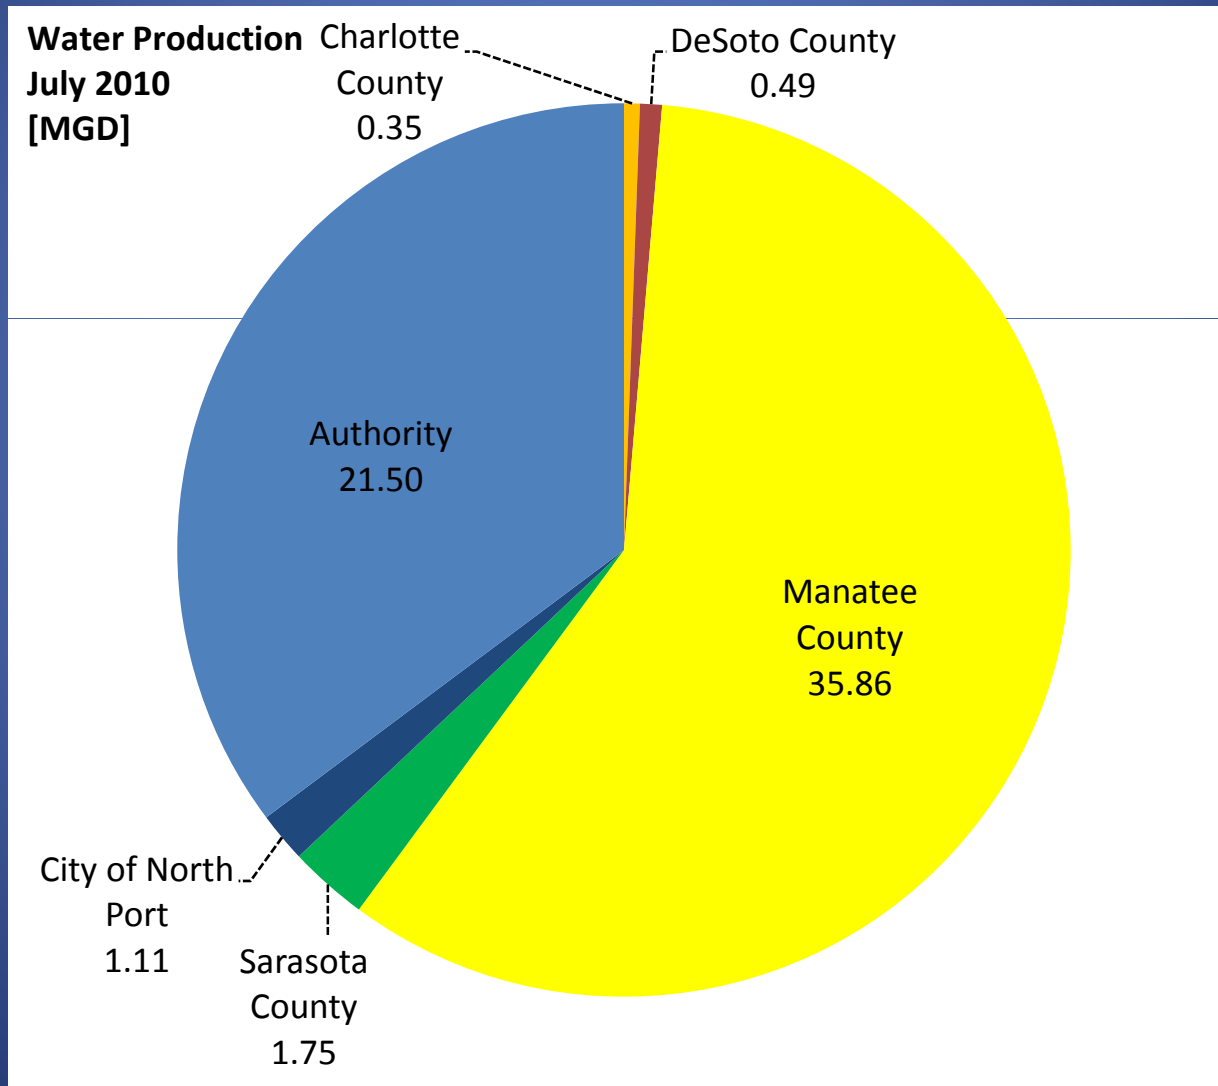


Used and Unused Production Capacity – July 2010

Regional Capacity
102 MGD

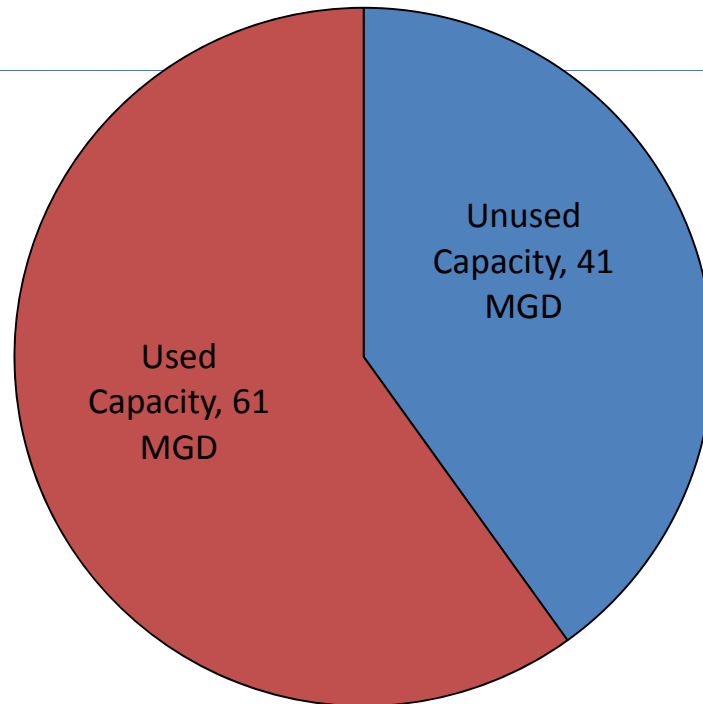


Authority & Customer Unused Capacity (MGD) – July 2010

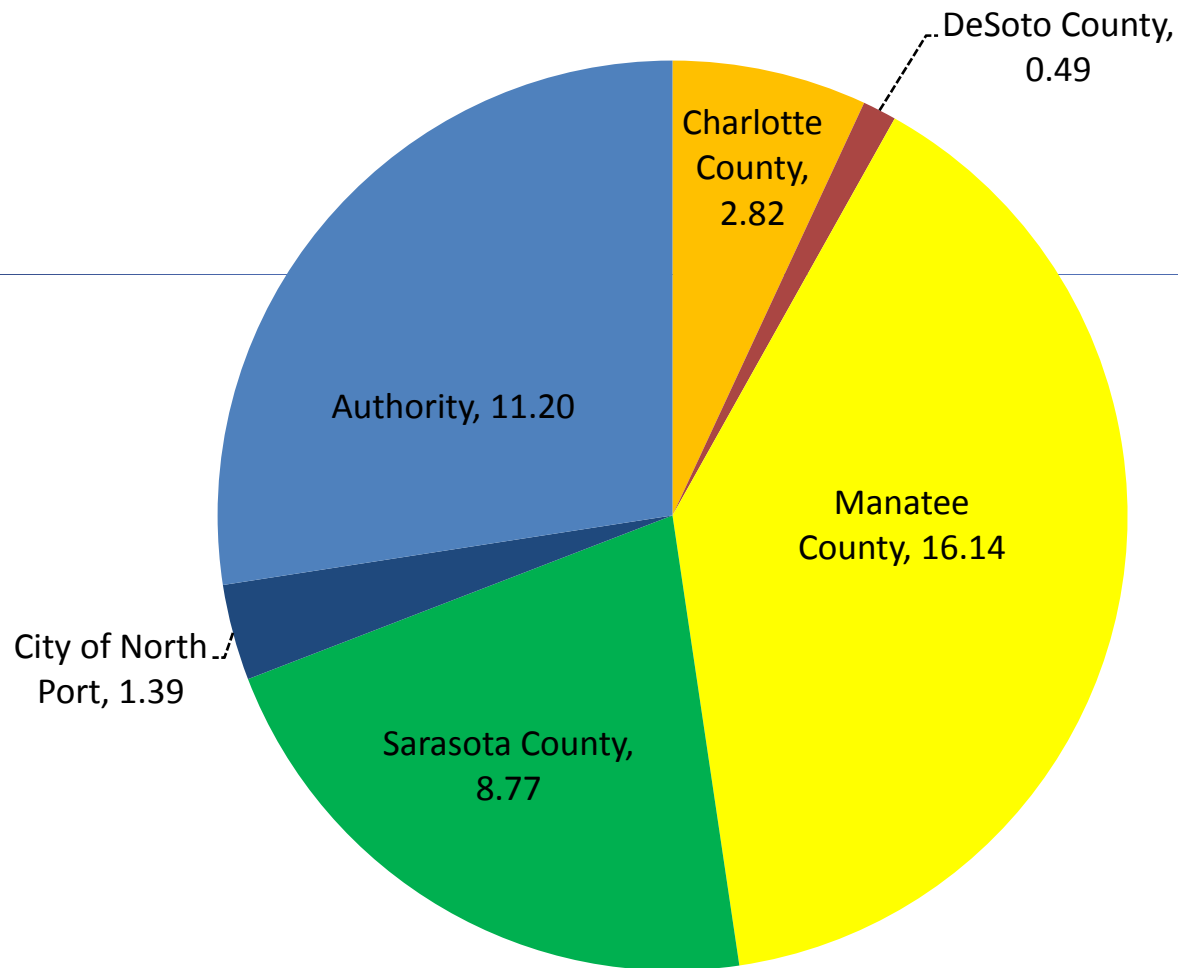


Individual Customer Use July 2010


Charlotte County

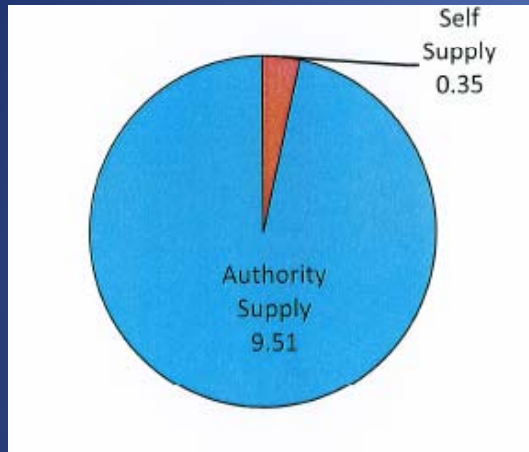


DeSoto County

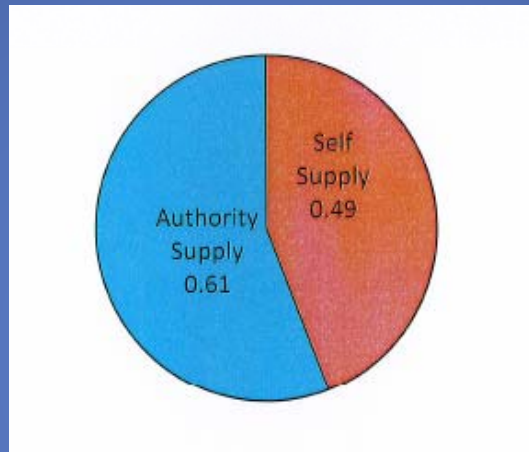


Manatee County

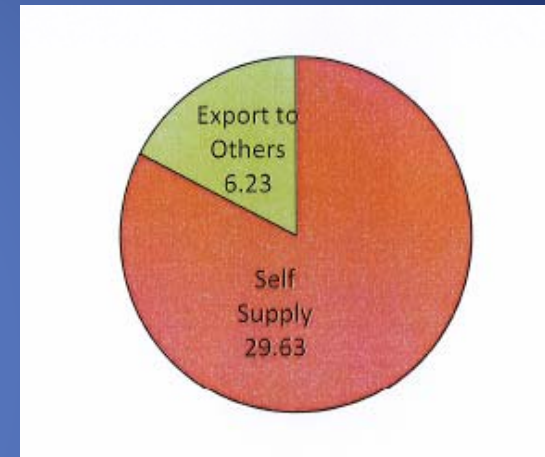


Sarasota County

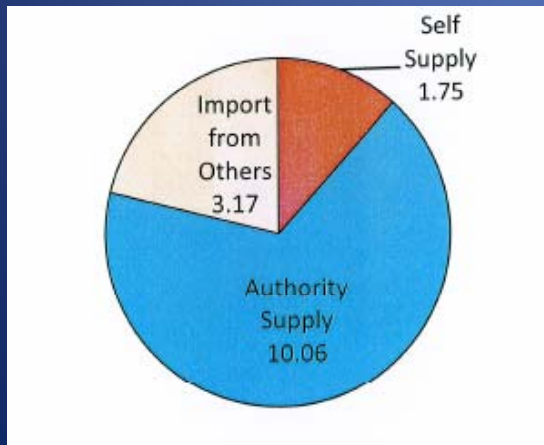

North Port

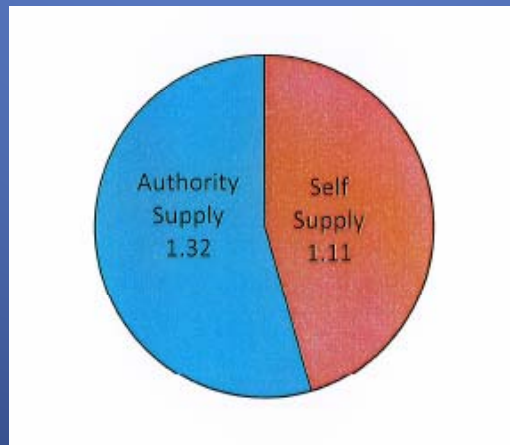

Interconnected Regional System

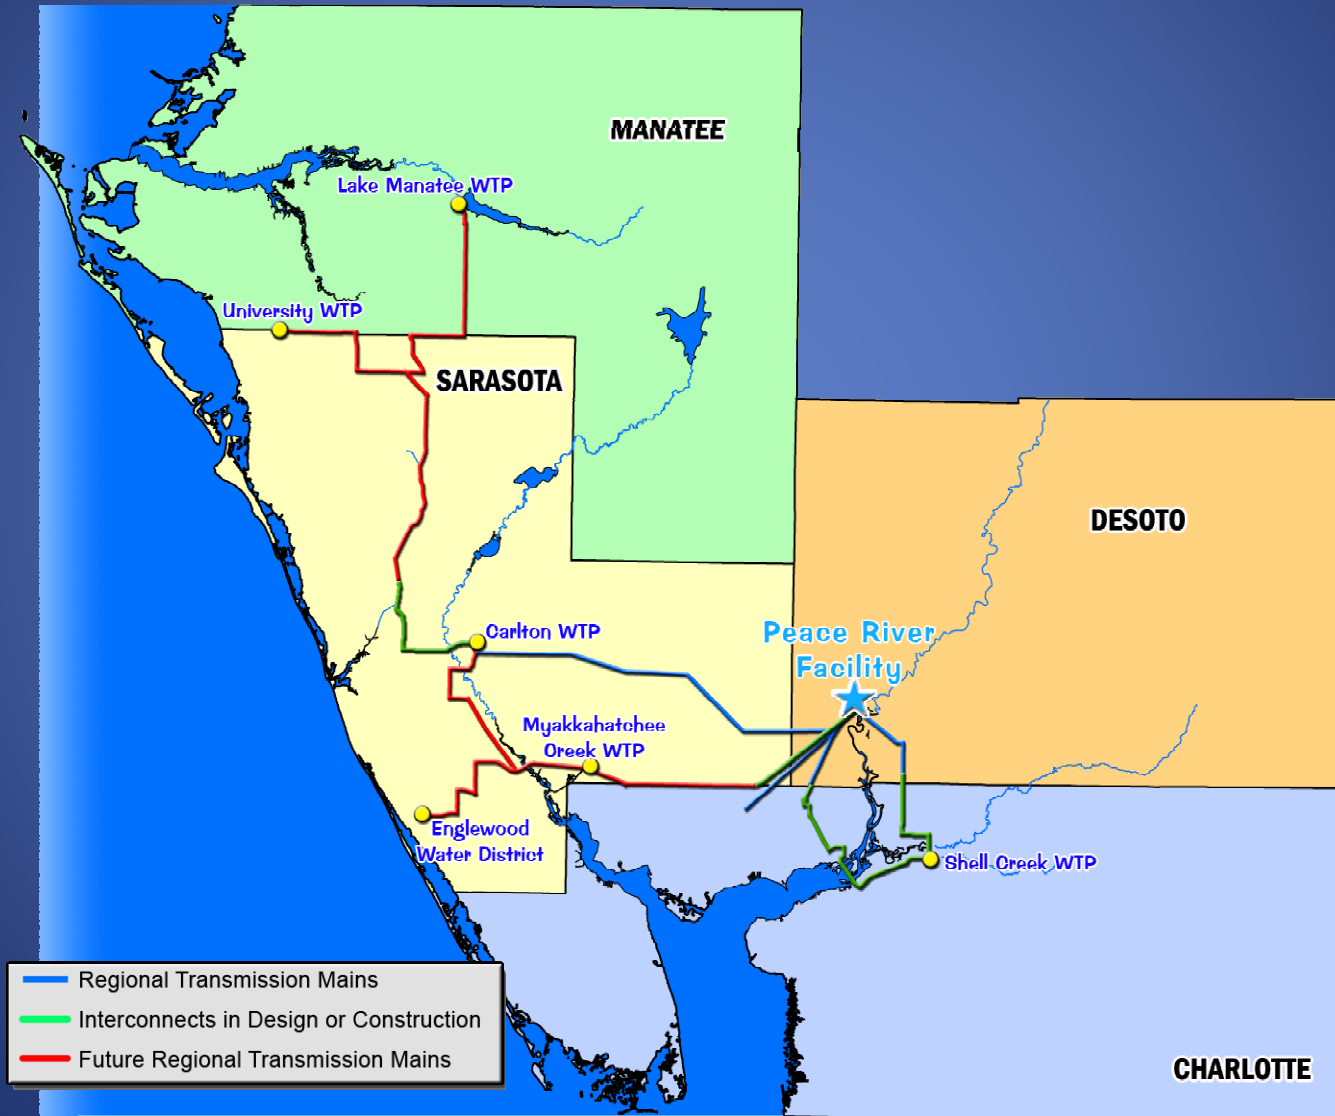

Questions