

# Water Resources / Supply Report

Agenda Item 12


October 6, 2010

# Supply Conditions


- Ceased recharge to ASR WF # 2 in September
- Began recharge to ASR WF # 1 in September
- Raw water reservoirs are 97% full
- Demand on the PRF is about 21.3 mgd
- Water quality is excellent

# Regional Water Supply


## 4-County Area (including Phase 1A Interconnect)

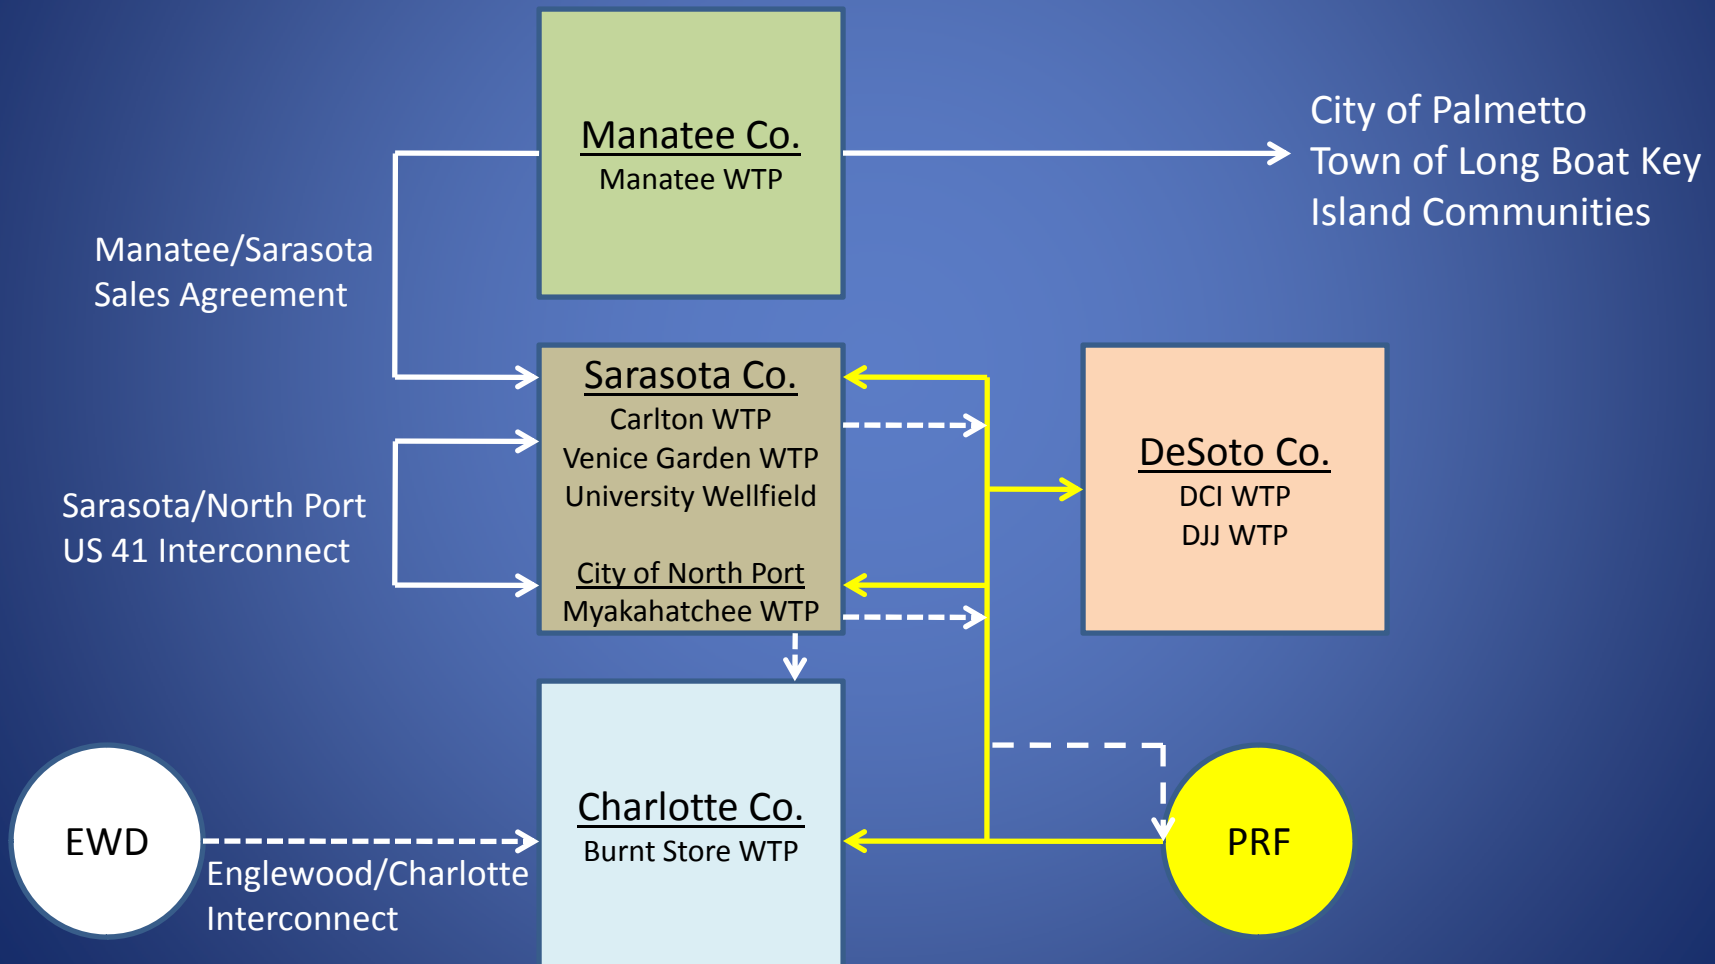


# Interconnected Regional System

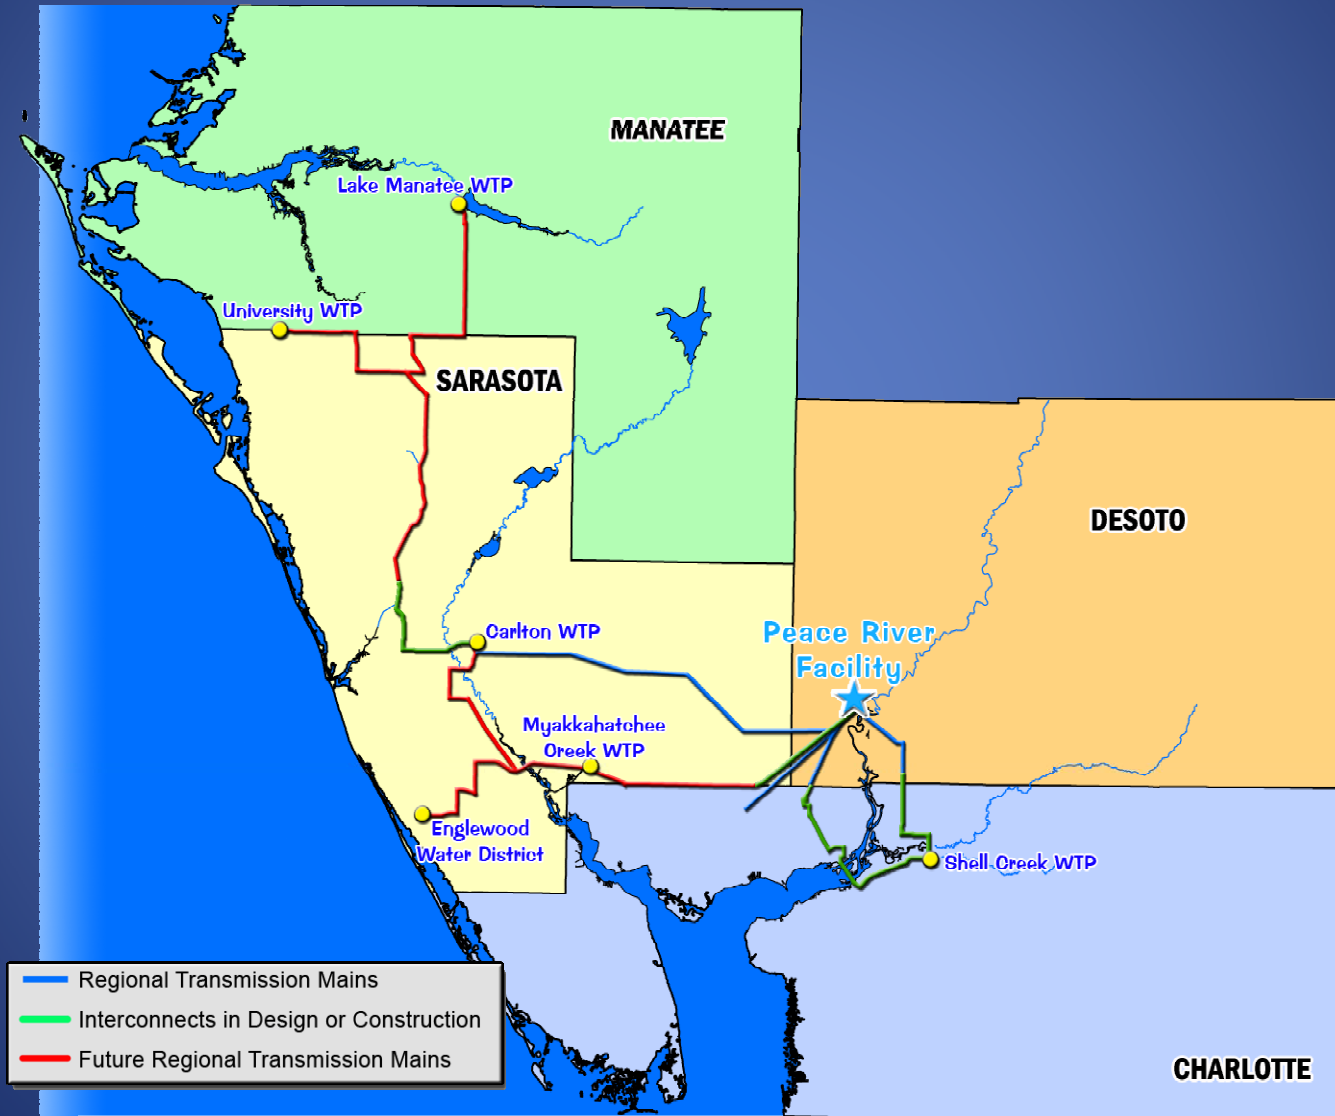


# Authority Customer Finished Water Supply Capacity

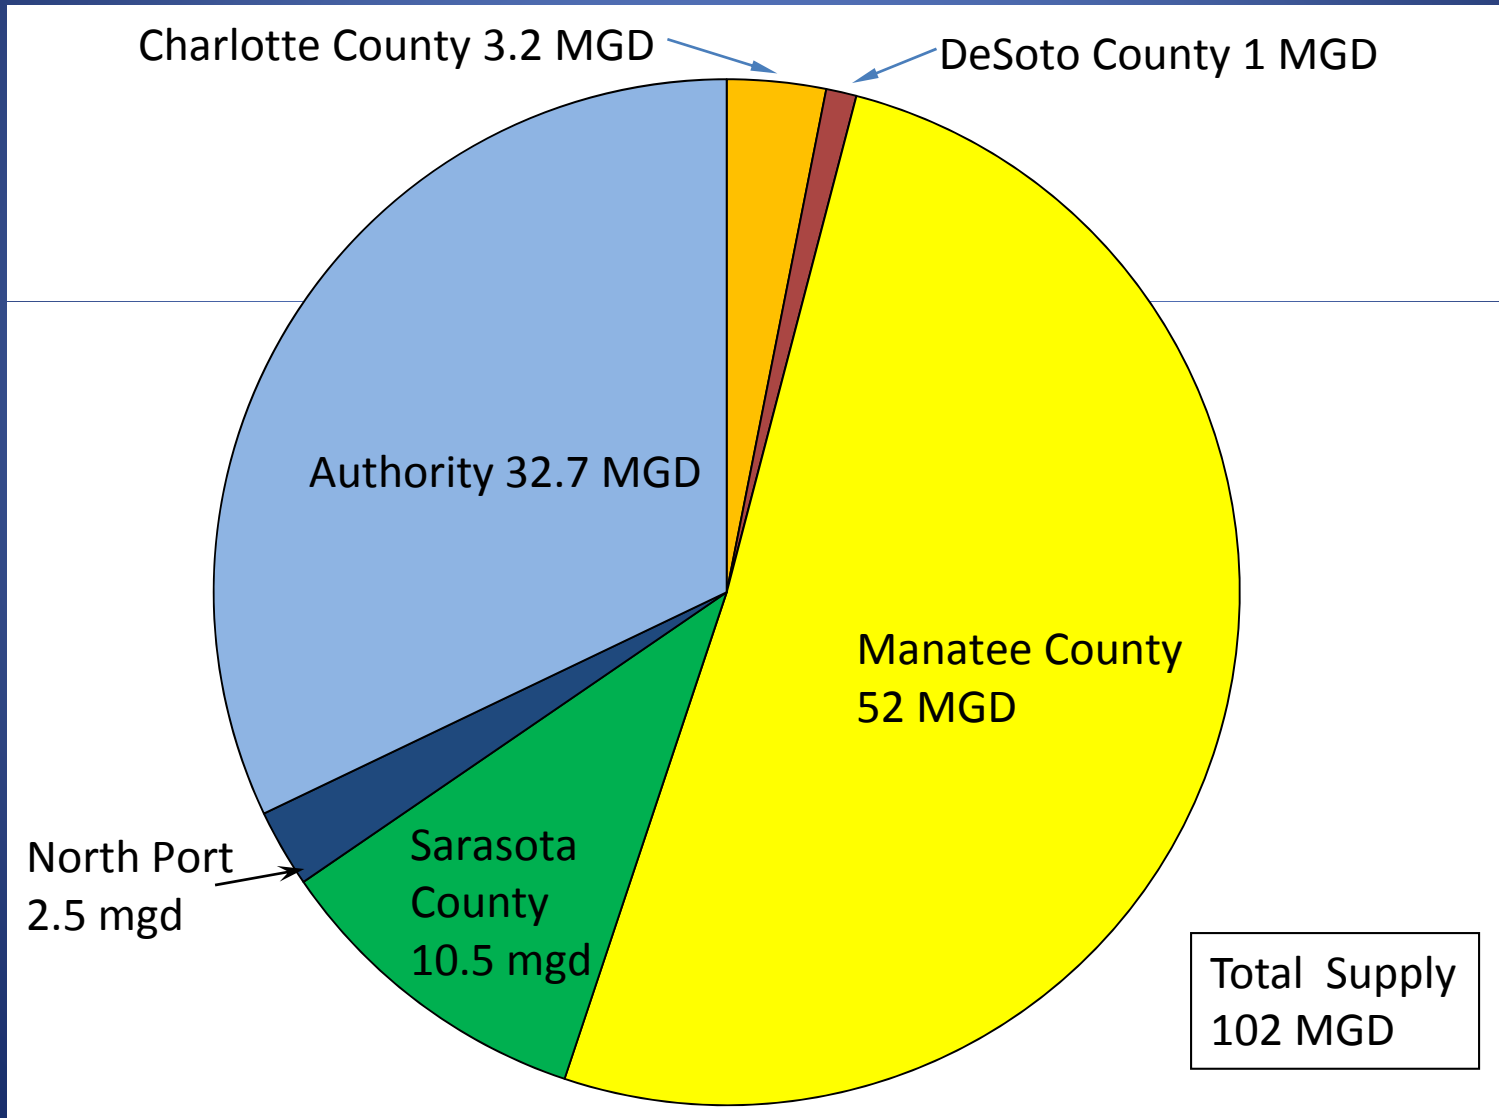

# August 2010 Authority & Customer Water Production (MGD)

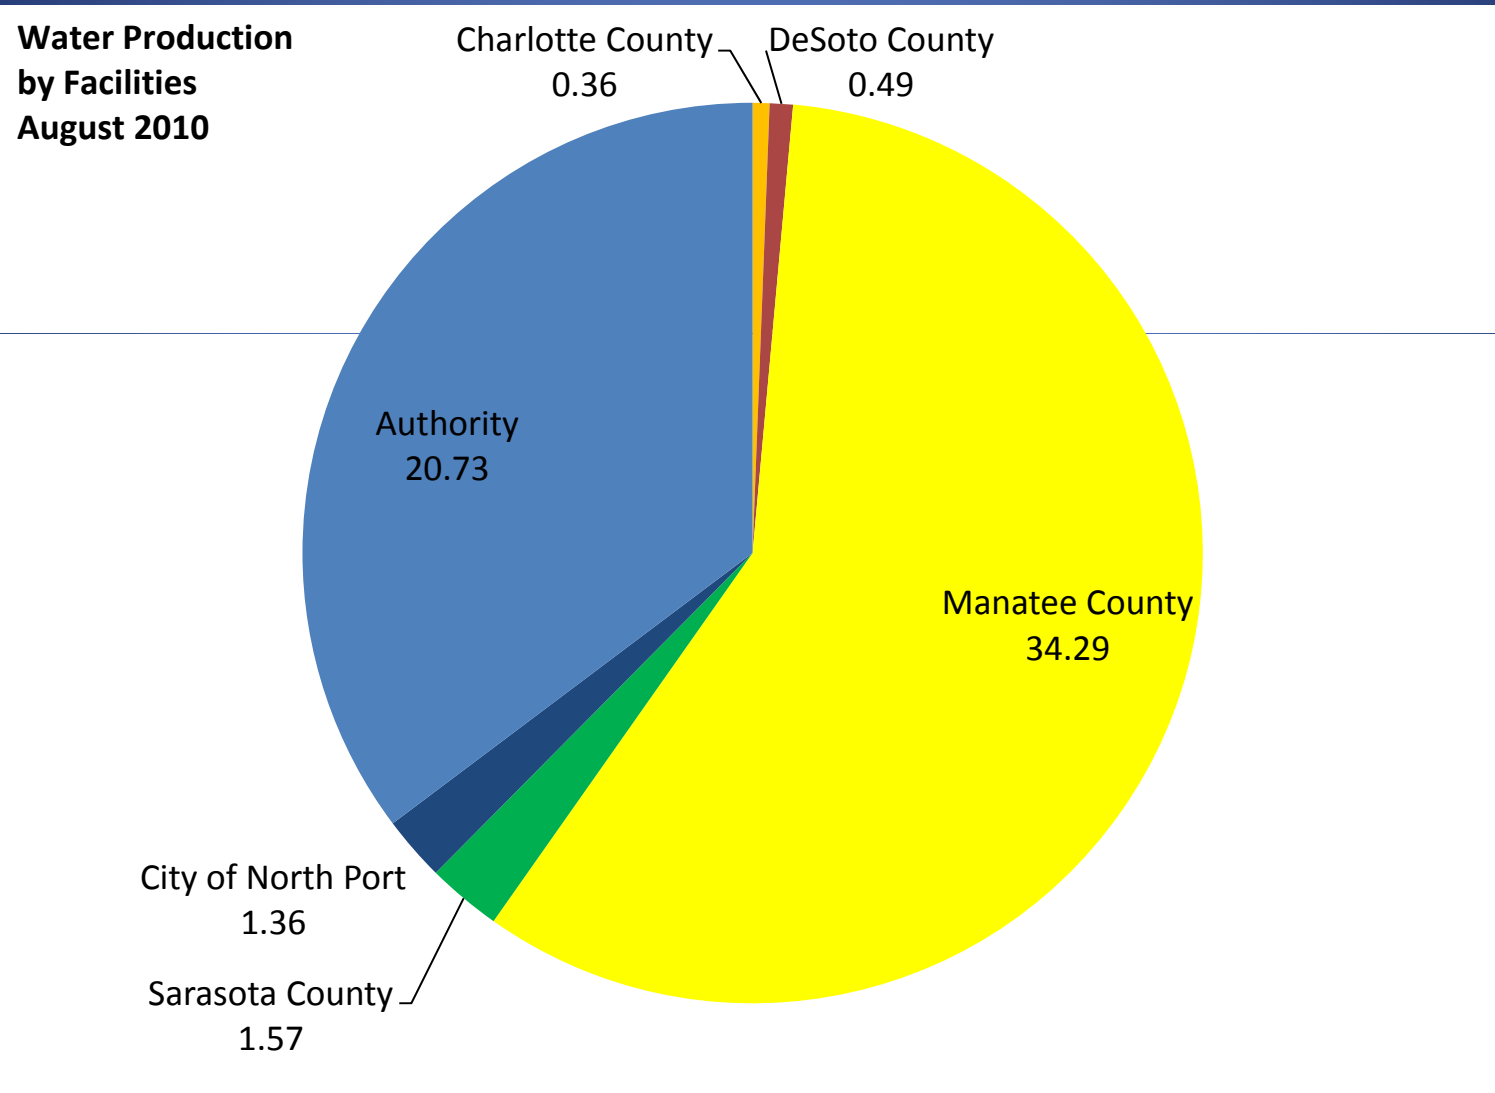

# August 2010 Unused Capacity

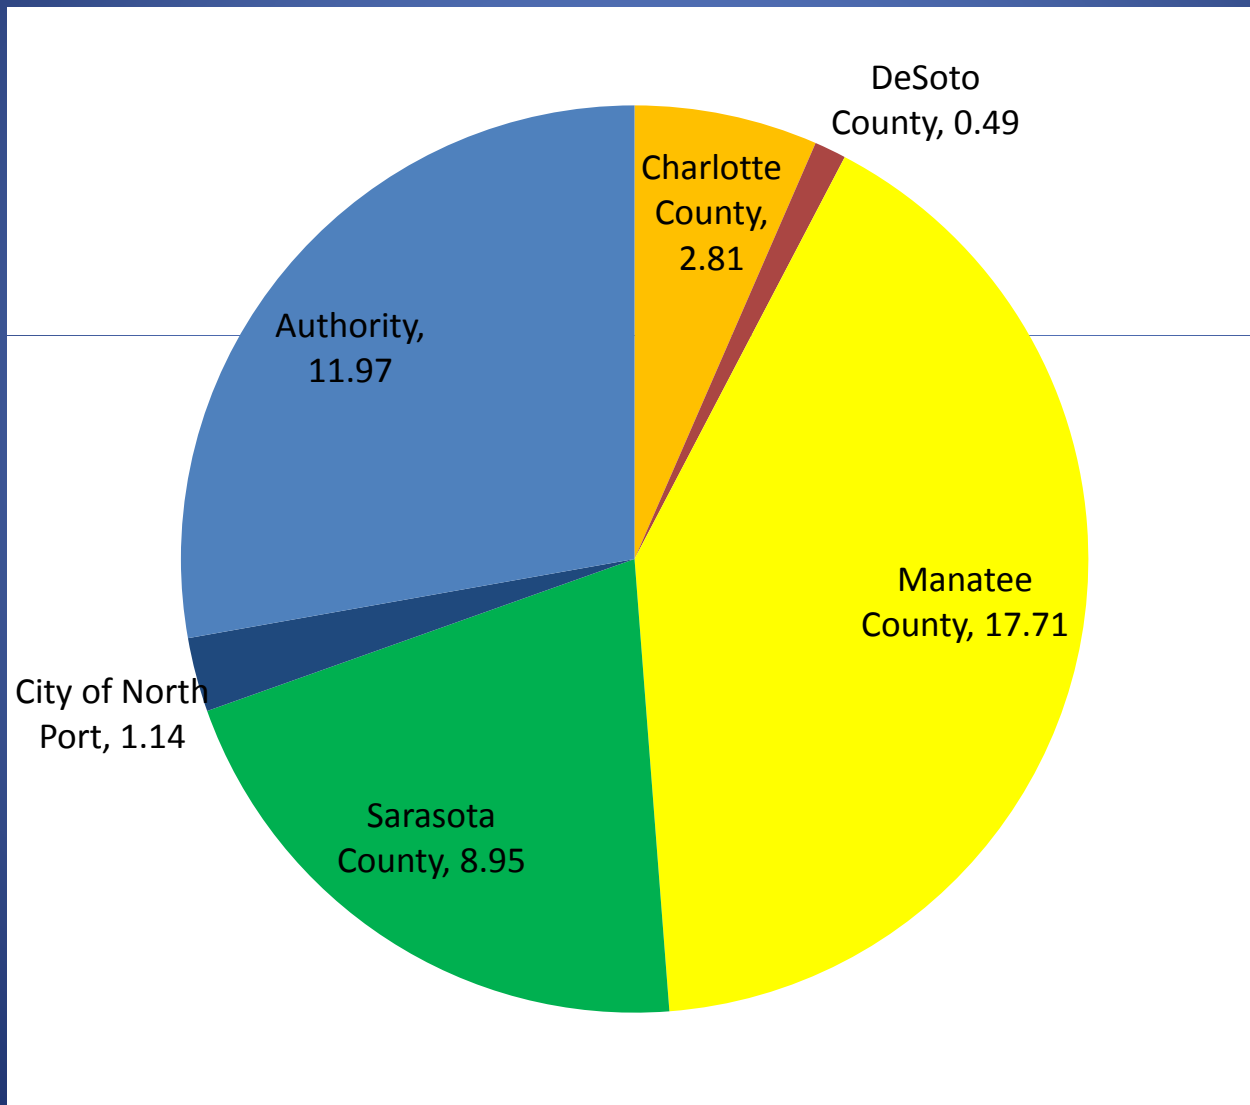


# Individual Customer Use August 2010


Charlotte County




DeSoto County

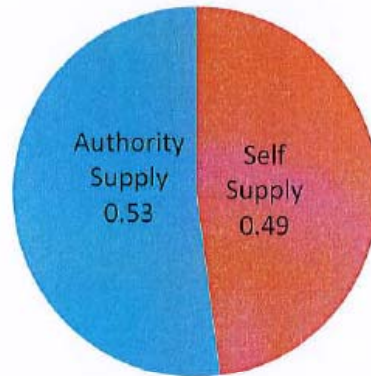

Manatee County

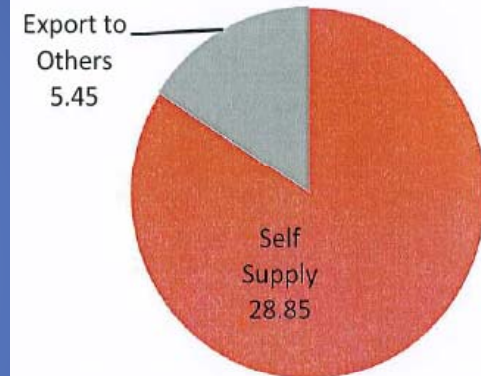


Sarasota County

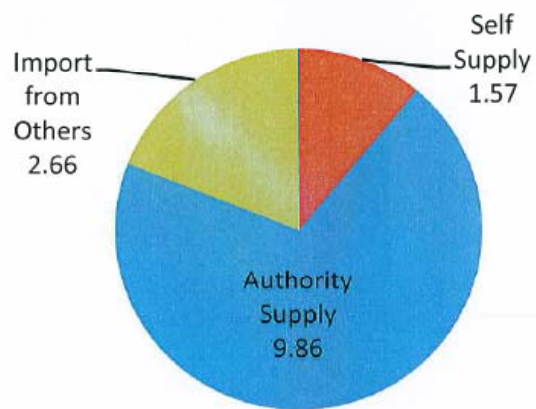

North Port



# Interconnected Regional System

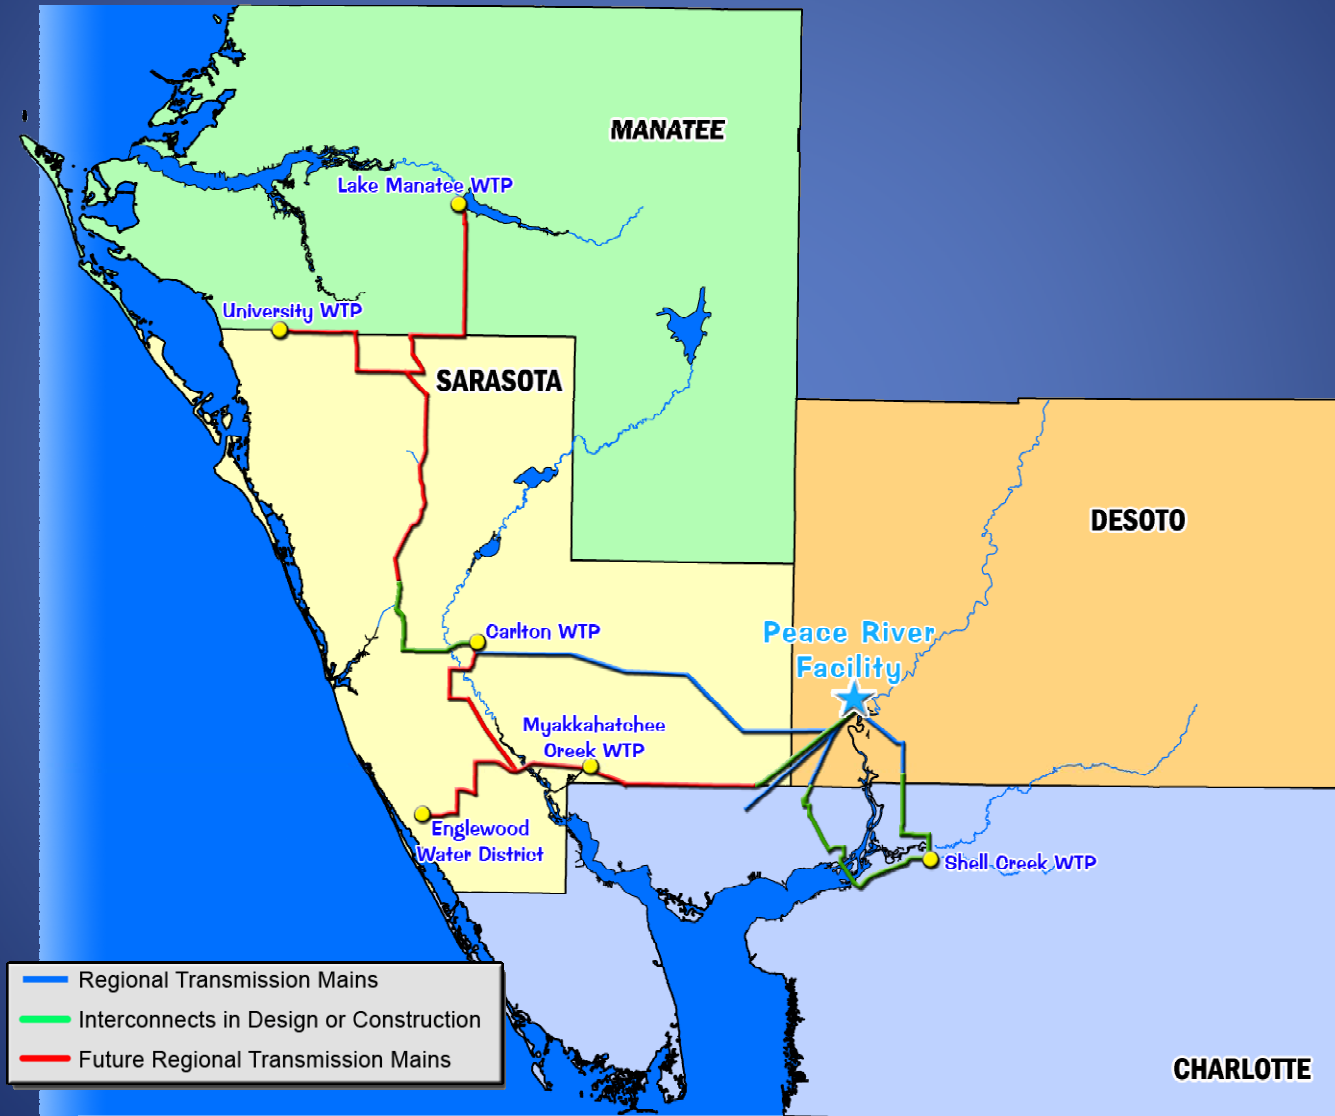

Questions